


A4 CONDENSATE DRAIN TRAP DETAIL

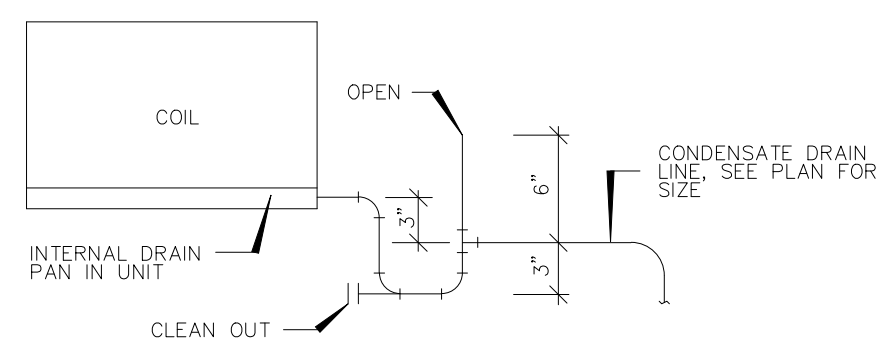

**NOTES:**

1. CONDENSATE DRAIN LINES SHALL BE GRADED CONTINUOUSLY AND UNIFORMLY TO POINT OF DISCHARGE, MINIMUM OF 1/8" PER FOOT.
2. CONDENSATE DRAINS SHALL BE TYPE "M" HARD DRAWN COPPER TUBING ASTM B-88
3. INSTALL CONDENSATE DRAINS PER MANUFACTURER'S REQUIREMENTS.
4. INSULATE PRIMARY COIL CONDENSATE INSIDE BUILDING IN ACCORDANCE WITH SHEET SPECIFICATIONS

---

## M1.1-CS