


**DESIGN LOADS:**  
DEAD LOAD = 3 p.s.f.(DECK + LIGHTS)  
+ WEIGHT OF STRUCTURAL COMPONENTS  
LIVE LOAD = 20 p.s.f.  
SNOW LOAD = 30 p.s.f.  
WIND LOAD = 105 m.p.h. EXP. C  
BLDG CODE = 2009 INTERNATIONAL BUILDING CODE  
EQUIVALENT LATERAL FORCE PROCEDURE  
LATERAL FORCE RESISTING SYSTEM = CANTILEVERED COLUMN  
SYSTEM-ORDINARY STEEL MOMENT FRAME  
SITE CLASS = C  
Ss (0.2) = 0.19  
SI (1.0) = 0.06  
SDS = 0.15  
SD1 = 0.07  
Fa = 1.20  
Fv = 1.70  
R = 1.25  
IMPORTANCE FACTOR = 1.0  
OCCUPANCY CATEGORY = II  
SEISMIC DESIGN CATEGORY = A  
CS = 0.118  
CONSTRUCTION TYPE = IIB  
OCCUPANCY CATEGORY = M  
TOTAL SEISMIC BASE SHEAR BOTH DIRECTIONS = 6.07 KIPS

**LANE**  
**SUPPLY, INC.**  
120 FAIRVIEW  
ARLINGTON, TX. 76010  
(817) 261-9116

SEAL

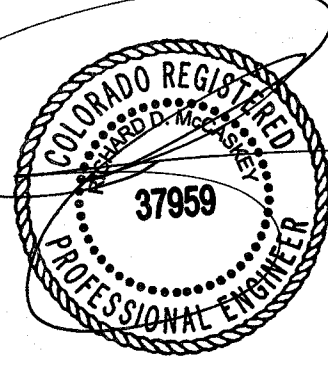

JAN 20 2015

NO.	DATE	REVISIONS	DRAWN	CHK'D
0	1/19/2015	PERMIT SET	CP	

LSC: 53516  
DRAWN BY: CP  
CHECKED BY:  
DATE: 12/29/2014

CIRCLE K STORES, INC.  
CIRCLE K FUEL CANOPY  
FOUNTAIN BLVD. & ACADEMY LOOP  
COLORADO SPRINGS, CO  
42'-10" X 150'-2" CANOPY

SHEET TITLE

CA - 4

**FOR BID ONLY**

**SECTION @ COLUMN**  
SCALE: NONE

**C**  
CA-3

**DETAIL**  
Scale: N.T.S.

**1**

**DETAIL**  
Scale: N.T.S.

**2**